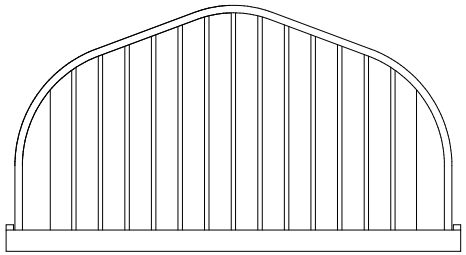

REAR ELEVATION

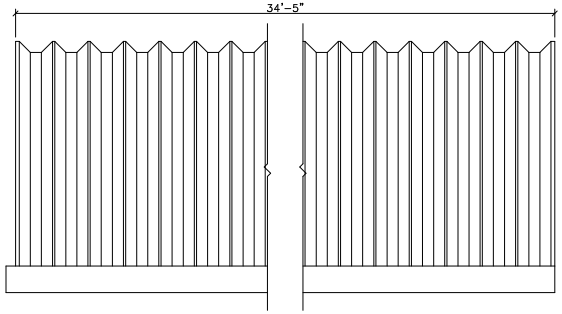

SIDE ELEVATION

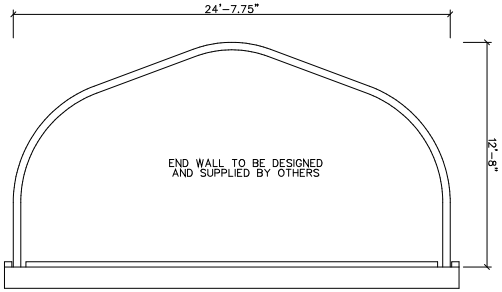

FRONT ELEVATION

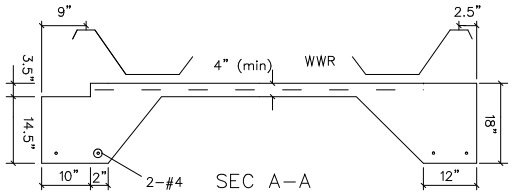

SEC A–A

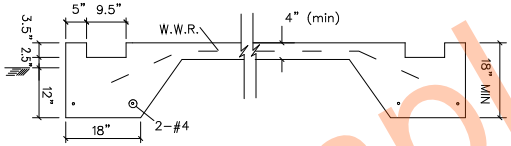

SEC B–B

WARNING: DO NOT REMOVE OR REDUCE THE CONCRETE FLOOR OR THE REINFORCING STEEL, AND/OR RAISE THE TOPS OF THE FOOTERS ABOVE THE FLOOR OR BUILDING FAILURE MAY RESULT

Minimum Concrete Cover:
(a) Concrete Cast against earth: 3"
(b) Concrete exposed to earth or weather:
No. 6 through No. 10 bars: 2"
No. 5 bar and smaller: 1.5"
(c) Concrete not exposed to earth or weather: 0.75"

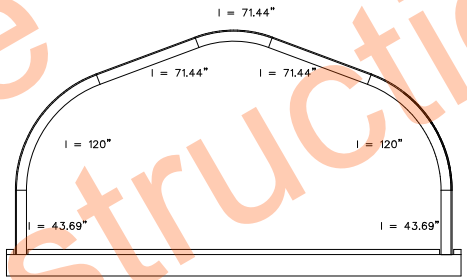

ARCH PROFILE

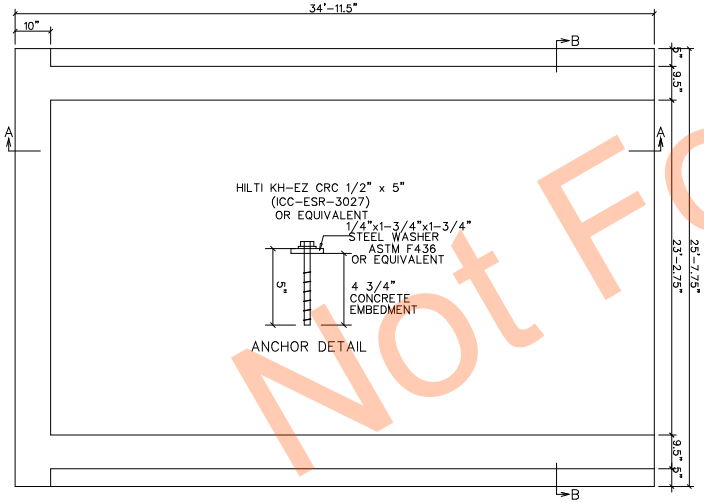

ANCHOR DETAIL

FOUNDATION PLAN

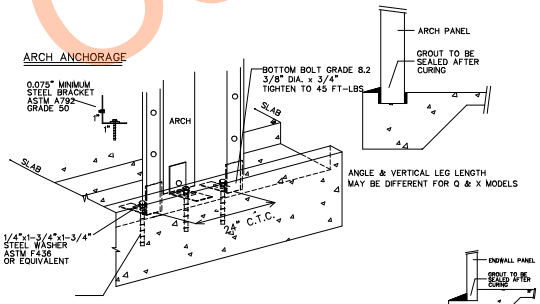

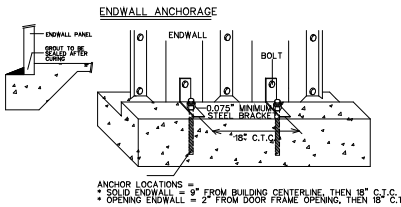

GENERAL NOTES

1. ALL MATERIAL AND WORKMANSHIP SHALL CONFORM WITH THE REQUIREMENTS OF THE LATEST REVISION OF THE INTERNATIONAL BUILDING CODE 2006. DESIGN ACCORDING TO NASPEC–01, NORTH AMERICAN SPECIFICATION FOR THE DESIGN OF COLD–FORMED STEEL STRUCTURAL MEMBERS, AND WITH ANSI/ASCE 7–05.
2. NO LOADS OTHER THAN THOSE GIVEN UNDER "DESIGN DATA" BELOW SHALL BE IMPOSED ON THE "STRUCTURE"
3. SPECIFIC NOTES AND DETAILS SHOWN ON THE DRAWINGS SHALL TAKE PRECEDENCE OVER THE BUILDING MANUAL SUPPLIED.
4. THE BUILDING, INCLUDING THE FOUNDATION, MUST BE CONSTRUCTED IN STRICT ACCORDANCE WITH THE DRAWING AND ERECTION INSTRUCTIONS. ANY DEVIATION, UNLESS APPROVED BY US IN WRITING, SHALL NULLIFY OUR CERTIFICATE AND SEAL AND SHALL BE THE SOLE RESPONSIBILITY OF THE ERECTOR.
5. A PROFESSIONAL ENGINEER SHOULD BE RETAINED WHERE SITE INSPECTIONS ARE WARRANTED.
6. NO ARCH PANEL MAY BE CUT OR MODIFIED UNLESS IT IS TO ACCOMMODATE AN ACCESSORY PROVIDED BY THE MANUFACTURER IN ACCORDANCE WITH ITS INSTRUCTIONS AND/OR THIS DRAWING.
7. MINIMUM SEPARATION FROM THIS BUILDING TO ANY TALLER BUILDING MUST BE THE SMALLER OF 20 FEET AND 6 TIMES THE HEIGHT DIFFERENCE.
8. IF SEALED BY AN ENGINEER, THIS DRAWING IS FOR PERMIT APPLICATION. OTHERWISE IT IS A DRAFT AND NOT FOR CONSTRUCTION.

FOUNDATION NOTES

NOTE: THE FOUNDATION ON THE DRAWING SPECIFIES THE MINIMUM REQUIREMENTS. LOCAL BUILDING CODE AND SITE CONDITIONS MAY REQUIRE A STRONGER FOUNDATION, WHICH MUST BE DESIGNED BY A LOCAL ENGINEER.
1. THE FOUNDATION SHALL BE FOUNDED ON NATURAL UNDISTURBED SOIL CAPABLE OF SAFELY SUSTAINING 1500 psf. THIS SHALL BE DESIGNED TO FULLY RESIST ALL ROTATION AT THE BASE OF THE ARCH.
2. SLAB ON GRADE SHALL BE PLACED ON WELL COMPACTED SOIL CAPABLE OF SUSTAINING 1500 psf WITHOUT APPRECIABLE SETTLEMENT.

DESIGN DATA (MATERIALS)

1. CONCRETE F'c = 2500 PSI @ 28 DAYS, ACI
2. REINFORCING STEEL GRADE 40, Fy = 40 KSI, ASTM A615
3. W.W.R. Fy = 65 KSI, ASTM A185.
4. W.W.R. 6 x 6 – W1.4 x W1.4

ARCH DATA



ENDWALL DATA



BOLTS: SAE GRADE 2 OR ASTM A307
ARCH STEEL THICKNESS – SEE ARCH PROFILE
ENDWALL STEEL THICKNESS = 0.03 in.

GALVALUM
STRUCTU
55% ALU
ASTM A7
50 KSI M
65 KSI M
HSS SEC
AST
W SECTI
AST
OTHER S
AST

ARCH DES
Lo: ROOF
Pg: GROUN
Ce: EXPOS
Ct: THERM
IMPORTANC
CATEGORY
Pnet: COM
V : BASIC
Kh: VELOC
GCpi: PRO
AND
Kd: WIND
Kzt: TOPO
IMPORTANC
WIND EXPO
SEISMIC DI

792–03
6)
/ASCE 7–05:
0
CIENT

LEGAL NOTE

This drawing is the property of Future Steel Buildings Intl. Corp. Any duplication of this drawing in whole or in part is strictly forbidden. Anyone doing so will be prosecuted under the full extent of the law.

REVISIONS:

ENGINEER'S SEAL:

Future Steel Buildings Intl. Corp.
220 Chrysler Drive, Brampton, Ontario, Canada, L6S 6B8, Phone: (905) 790–8500

SCALE: N.T.S.	APPROVED BY:
DATE: 2024–10–28	CHECKED BY:
PROJECT:	
A25–13	
MODEL:	DRG:

Sample
Not For Construction